

WAAS CH 99601 W22A	APP CRS 216°	Rwy Idg 12003 TDZE 637 Apt Elev 645	RNAV (GPS) Z RWY 22L DETROIT METRO WAYNE COUNTY (DTW)
--	------------------------	--	---


RNP APCH.

▼ For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -10°C (14°F) or above 54°C (130°F). Simultaneous approach authorized. LNAV procedure NA during simultaneous operations. Use of FD or AP required during simultaneous operations. For inop ALS, increase LNAV/VNAV all Cats visibility to RVR 4500 and LNAV Cat C/D visibility to 1½ SM. #RVR 1800 authorized with use of FD or AP or HUD to DA.

MALSR

MISSED APPROACH:
Climb to 4000 direct
HWLER and hold.

D-ATIS 133.675	DETROIT APP CON 124.05 284.0	METRO TOWER 128.125 317.725	GND CON 121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)	CLNC DEL 120.65	CPDLC
--------------------------	--	---------------------------------------	---	---------------------------	-------

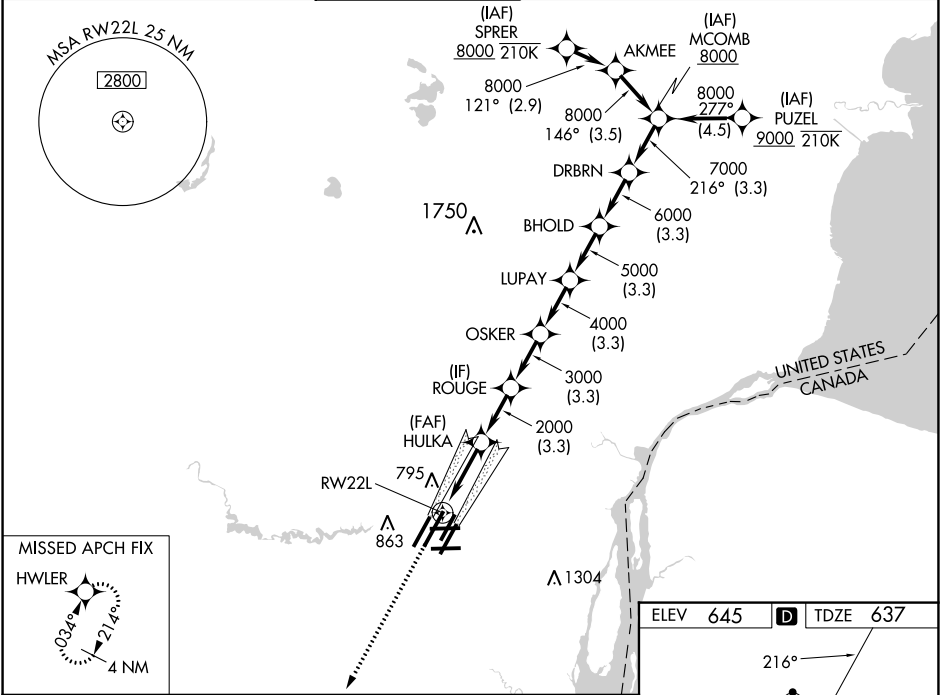

4000 HWLER

*LNAV only.

CATEGORY	3	A	B	C	D
LPV DA#		837/24	200 (200-½)		
LNAV/VNAV DA		938/24	301 (300-½)		
LNAV MDA		1100/24 463 (500-½)	1100/50 463 (500-¾)		
CIRCLING		1180-1 535 (600-1)	1180-1½ 535 (600-½)	1240-2 595 (600-2)	

TDZ/CL Rwy 3R, 4L, 4R and 22R

REIL Rwy 3L, 9L, 9R and 21R

HIRL all runways